





Building corner ~10'
from T-line centerline

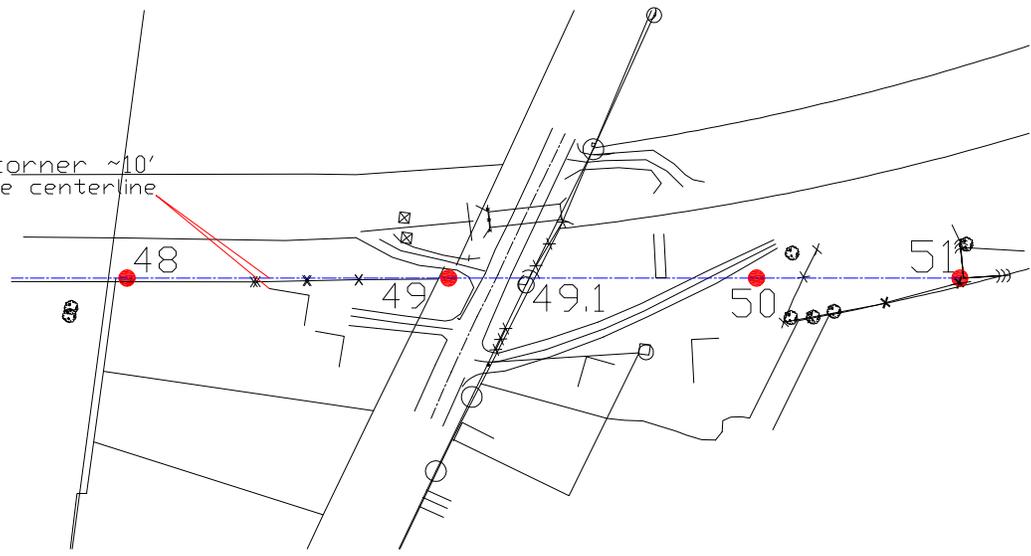

PLAN VIEW

69kV CONDUCTOR
T2-PENGUIN
DISPLAYED @ 212°F

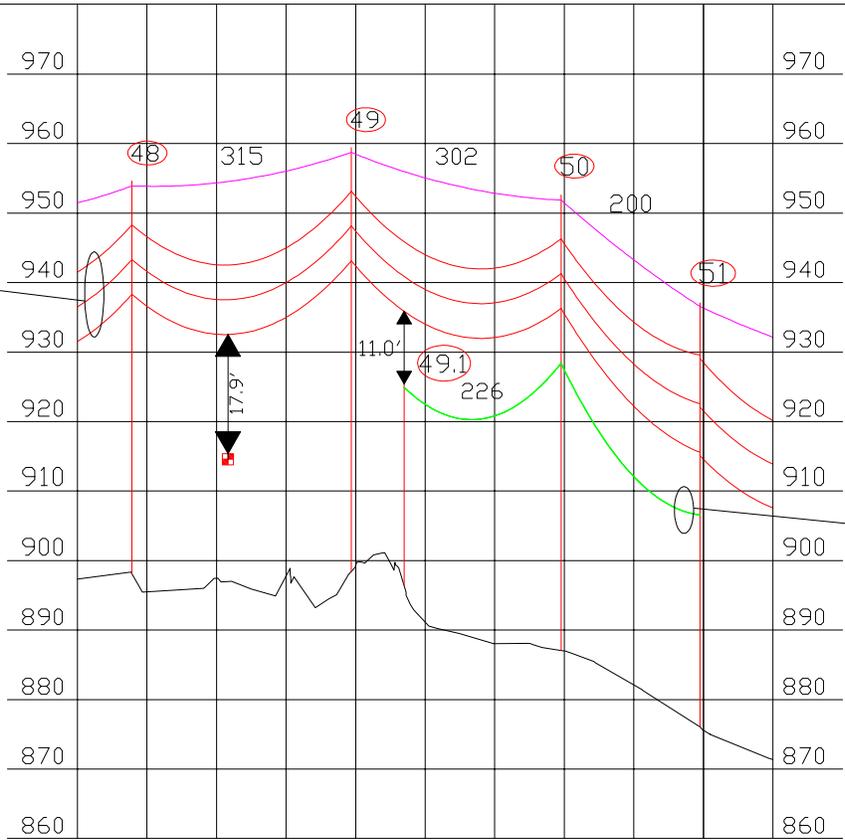

UB CONDUCTOR
DISPLAYED @ 32°F 1" ICE

RECEIVED
January 28, 2013
E-20994
(Amendment No. 10)

CONFIDENTIAL

These documents are for the use of ITC Holdings Corp. ITC Holdings Corp. disclaims all warranties, both expressed and implied. Use by anyone other than ITC Holdings Corp. is at their own risk.

ITC Midwest
Hiawatha - Lafayette
Linn County, IA

NO.	DATE	REVISION	BY
1	01/18/2013	REVISE FOR IUB	MBN
*	12/6/2012	ORIGINAL ISSUE	MBN
			CHK'DAPV'D



Hiawatha - Lafayette
Linn County, IA
Clearance to Building in
Section 29, T85N, R7W
Scale: DWG. NO. 20323-54-02